GENERAL NOTES - THIS SHEET

1. ALL 120V RECEPTACLES ARE TO BE TAMPER RESISTANT.
2. ALL RECEPTACLES ON 20 AMP CIRCUIT TO BE 20 AMP RECEPTACLES.
3. COORDINATE EXACT LOCATION OF WH, AH, & HP W/ P.C. & M.C. BEFORE BEGINNING WORK.
4. E.C. TO CONFIRM ALL APPLIANCE LOCATIONS W/ARCH PLANS PRIOR TO BEGINNING WORK.
5. PROVIDE EXTRA BRACING FOR ANY CEILING FAN.
6. CONTRACTOR SHALL VERIFY THE EXACT LOCATIONS AND MOUNTING HEIGHTS FOR ALL OUTLETS BEFORE STARTING "ROUGH-IN" WORK. CONTRACTOR SHALL NOT "ROUGH-IN" ANY OUTLET, FIXTURE OR DEVICE OF ANY KIND WITHOUT FIRST ATTENDING A WALK THROUGH OF EACH APARTMENT UNIT WITH THE OWNER AND GENERAL CONTRACTOR FOR COORDINATION OF FINAL LOCATIONS.
7. UNIT PANELS ARE TO BE INSTALLED SO THAT NO TRIM LATCH ON BREAKER IS GREATER THAN 48" AFF.
8. SEE BUILDING PLANS FOR RATING OF UNIT DEMISING WALLS & FLOOR CEILING ASSEMBLIES.
9. COORDINATE VISUAL/HEARING IMPAIRED UNIT DESIGNATIONS WITH G.C. AND ARCH PRIOR TO BID.
10. NOTIFICATION DEVICES SHALL COMPLY WITH 2017 FLORIDA ACCESSIBILITY CODE 809.5.5.

TAGGED NOTES - THIS SHEET

1. PROVIDE A SIMPLEX RECEPTACLE FOR MICROWAVE UNIT. MOUNT RECEPTACLE AT BACK OF UPPER CABINET; MICROWAVE UNIT IS MOUNTED OVER RANGE. COORDINATE EXACT LOCATION W/ G.C..
2. PROVIDE CHANNEL VISION BRAND STRUCTURED WIRING ENCLOSURE FOR NETWORKING PURPOSES WITHIN APARTMENT FOR MODULAR PUSH AND LOCK TELEPHONE, VIDEO, DATA, AND POWER MODULES. THE CABLE TV COAX AND TELEPHONE/DATA CAT.5 FEED FROM THE LOWER LEVEL DATA ROOM(S) SHALL TERMINATE AT THIS BOX IN EACH APARTMENT. THEN FROM THIS BOX SPLIT OFF TO FEED EACH DATA/TELEPHONE/CABLE TV OUTLET WITHIN EACH APARTMENT. USE 19" MODEL C-011 9E IN THE 4BR AND 3BR UNITS AND USE 12" MODEL C-011 2WE IN THE 2BR AND 1BR UNITS. INSIDE THE SINGLE GANG KNOCKOUT PROVIDED IN EACH STRUCTURED WIRING ENCLOSURE, PROVIDE A DUPLEX ELECTRICAL POWER RECEPTACLE ON CIRCUIT NOTED.
3. CONFIRM EXACT LOCATION OF TV OUTLET W/ OWNER.
4. PROVIDE POWER FOR WATER METER COORD. LOCATOIN W/ P.C..
5. PROVIDE COUNTER TOP AIR SWITCH NEXT TO SINK FOR GARBAGE DISPOSAL. CONFIRM EXACT LOCATION W/ OWNER.
6. NOT USED.
7. PROGRAMMABLE EXHAUST FAN SWITCH PROVIDED BY M.C. INSTALLED BY AND PROGRAMMED(DIALS SET) BY E.C., SEE MECH PLAN.
8. PROVIDE (2) GFI RECEPTACLES FOR DISHWASHER AND GARBAGE DISPOSAL TO BE INSTALLED BELOW SINK IN READILY ACCESSIBLE LOCATION.
9. MECHANICAL CLOSET IS A RETURN PLENUM. ALL MATERIALS IN PLENUM ARE TO BE PLENUM RATED OR WRAPPED W/ PLENUM WRAP.

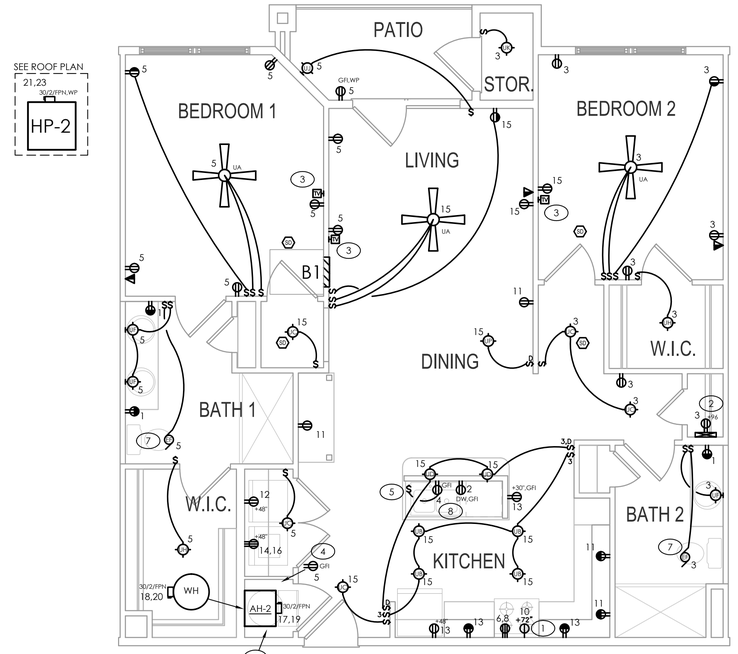

3 ELECTRICAL UNIT PLAN - TYPE 2.0 FAIR HOUSING WITH SHAFT

SCALE: 1/4" = 1'-0"

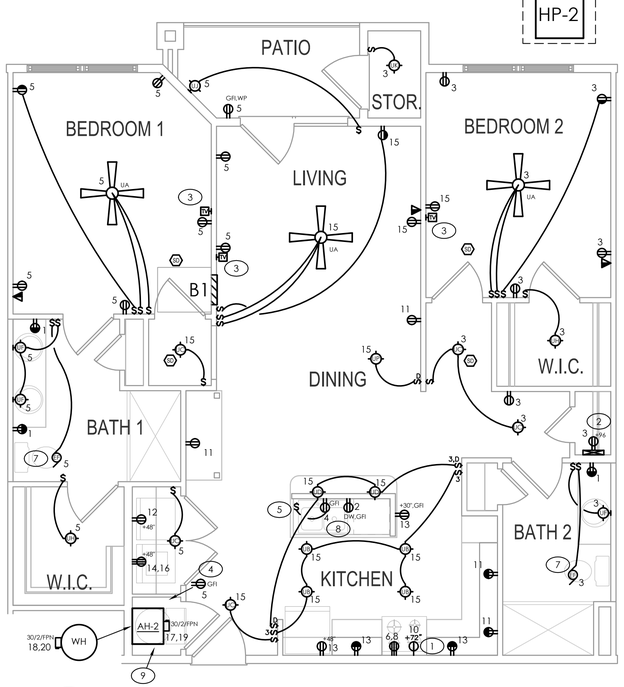

2 ELECTRICAL UNIT PLAN - TYPE 2.0 FAIR HOUSING WITH IDF

SCALE: 1/4" = 1'-0"

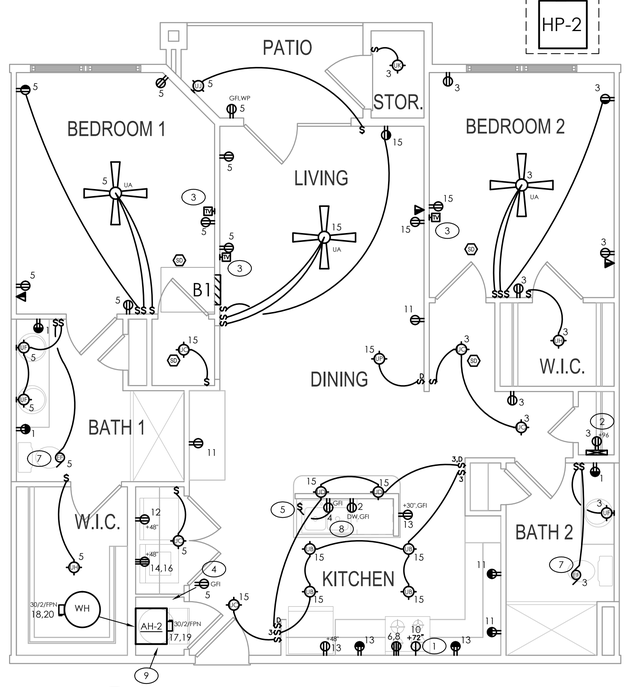

1 ELECTRICAL UNIT PLAN - TYPE 2.0 FAIR HOUSING

SCALE: 1/4" = 1'-0"

PLANWORX
ARCHITECTURE
5711 SIX FORKS ROAD, SUITE 100
RALEIGH NC 27609
website www.planworx.com

Digitally signed by Zack L. Tomlin, PE
DN: cn=Zack L. Tomlin, PE, o=Maple Engineering, PLLC, ou=Zack L. Tomlin, State of Florida, Professional Engineer, License No. 79002, This item has been digitally signed and sealed by Zack L. Tomlin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies., email=ZLT@maple-eng.com, c=US
Date: 2021.11.17 17:02:50 -05'00'

Oasis at Surfside - Phase II
Zimmer Development Company
Cape Coral, Florida
PERMIT SET

MAPLE
ENGINEERING, PLLC
708 ST. MARYS ST.
RALEIGH, NC 27605 LIC.#: P-0990
P:919-341-4247 F:919-890-3797
PLUMBING MECHANICAL ELECTRICAL

PROGRESS DATE:			
ISSUE DATE:	11/17/21		
REVISIONS NUMBER	DATE	INITIALS	DESCRIPTION

PROJECT NO: 002221
DRAWN BY: NHV
CHECKED BY: ZLT

SHEET TITLE:
ELECTRICAL UNIT PLANS

SHEET NUMBER:
E1.21

© 2021 MAPLE ENGINEERING, PLLC EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF MAPLE ENGINEERING, PLLC.

1. All drawings are to be coordinated with all site information by owner and contractor, and applicable codes.
2. Contractor is to notify architect immediately of conditions or items varying from depicted information.
3. Planworx Architecture, P.A. is not responsible for constructed variations from the information depicted.
4. Planworx Architecture, P.A. will not assume any liability for expenses associated with errors and omissions on these drawings unless offset by verified construction savings as a result of planworx architecture, P.A. Design.
5. Planworx Architecture, P.A. retains ownership of all of designs depicted and implied herein.
6. Planworx Architecture, P.A. is not responsible for estimating, maintaining, or regulating construction costs associated with these plans.

© Copyright 2021 - PLANWORX ARCHITECTURE, P.A. All rights reserved. Reproduction of this sheet, in whole or in part, is strictly prohibited. Plans may be used once by client. Unauthorized use strictly prohibited. PLANS NOT VALID FOR CONSTRUCTION W/O APPROPRIATE PROFESSIONAL SEALS.

11/17/2021 4:13 PM
PLX-21027-E1.21.DWG