

FIRE RATING LEGEND
--- 1-HR WALL
--- 2-HR WALL
* FLOOR/CEILING IS 1-HR RATED



PLANWORX
ARCHITECTURE

5711 SIX FORKS ROAD, SUITE 100
RALEIGH NC 27609
website www.planworx.com

Oasis at Surfside - Phase II

Zimmer Development Company

Cape Coral, Florida

PERMIT SET



MAPLE
ENGINEERING, PLLC
708 ST. MARKS ST.
RALEIGH, NC 27605 S.G.#: P 0090
P 0112-341-4247 F 0119-890-3797
PLUMBING MECHANICAL ELECTRICAL

PROGRESS DATE:
11/17/21

ISSUE DATE:
11/17/21

PROJECT NO: 002221


DRAWN BY: NIV

CHECKED BY: ZLT

SHEET TITLE:
**ELECTRICAL
FOURTH FLOOR
PLAN**

SHEET NUMBER:

E1.13

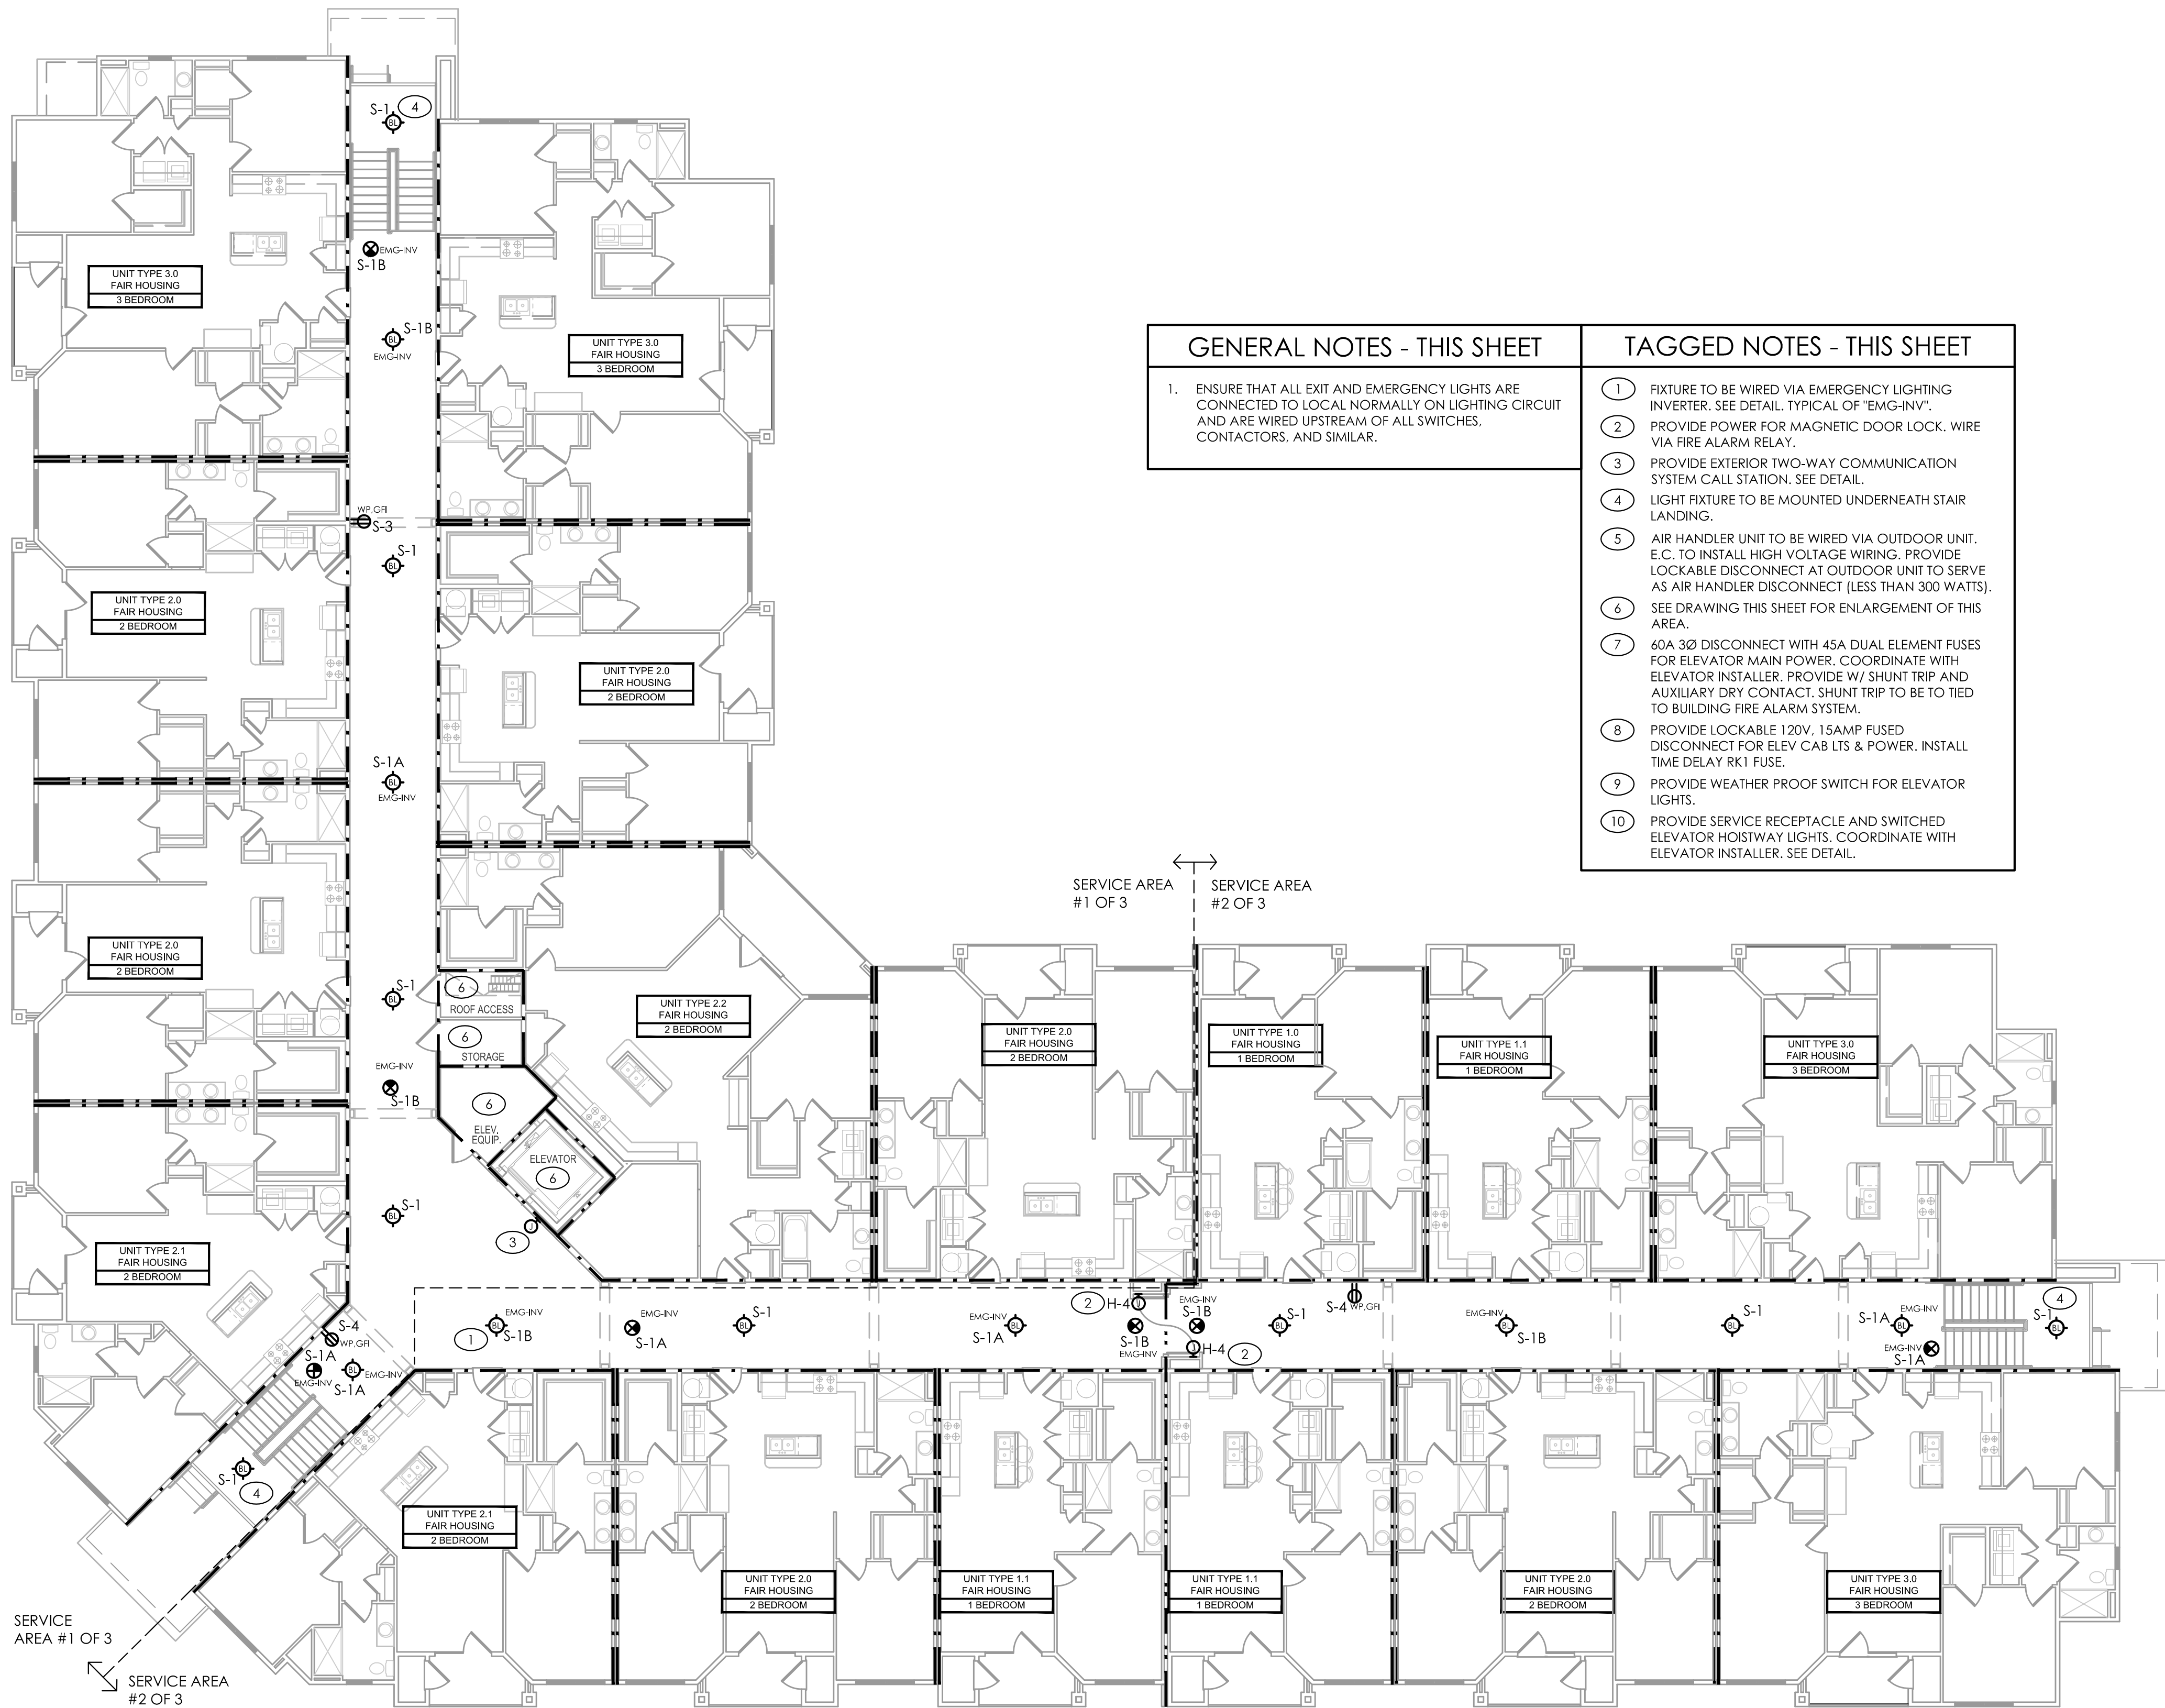

GENERAL NOTES - THIS SHEET	TAGGED NOTES - THIS SHEET
1. ENSURE THAT ALL EXIT AND EMERGENCY LIGHTS ARE CONNECTED TO LOCAL NORMALLY ON LIGHTING CIRCUIT AND ARE WIRED UPSTREAM OF ALL SWITCHES, CONTACTORS, AND SIMILAR.	1. FIXTURE TO BE WIRED VIA EMERGENCY LIGHTING INVERTER. SEE DETAIL, TYPICAL OF "EMG-INVT".
	2. PROVIDE POWER FOR MAGNETIC DOOR LOCK. WIRE VIA FIRE ALARM RELAY.
	3. PROVIDE EXTERIOR TWO-WAY COMMUNICATION SYSTEM CALL STATION. SEE DETAIL.
	4. LIGHT FIXTURE TO BE MOUNTED UNDERNEATH STAIR LANDING.
	5. AIR HANDLER UNIT TO BE WIRED VIA OUTDOOR UNIT. E.C. TO INSTALL HIGH VOLTAGE WIRING. PROVIDE LOCKABLE DISCONNECT AT OUTDOOR UNIT TO SERVE AS AIR HANDLER DISCONNECT (LESS THAN 300 WATTS).
	6. SEE DRAWING THIS SHEET FOR ENLARGEMENT OF THIS AREA.
	7. 60A 30 DISCONNECT WITH 45A DUAL ELEMENT FUSES FOR ELEVATOR MAIN POWER. COORDINATE WITH ELEVATOR INSTALLER. PROVIDE W/ SHUNT TRIP AND AUXILIARY DRY CONTACT. SHUNT TRIP TO BE TIED TO BUILDING FIRE ALARM SYSTEM.
	8. PROVIDE LOCKABLE 120V, 15AMP FUSED DISCONNECT FOR ELEV CAB LTS & POWER. INSTALL TIME DELAY RK1 FUSE.
	9. PROVIDE WEATHER PROOF SWITCH FOR ELEVATOR LIGHTS.
	10. PROVIDE SERVICE RECEPTACLE AND SWITCHED ELEVATOR HOISTWAY LIGHTS. COORDINATE WITH ELEVATOR INSTALLER. SEE DETAIL.

2 STORAGE/ELEVATOR RM ENLARGEMENT
SCALE: 3/16" = 1'-0"

1 ELECTRICAL FOURTH FLOOR PLAN
SCALE: 3/32" = 1'-0"