



MARK	MANUF.	CATALOG NUMBER	LAMP DATA		VOLTS	BALLAST DATA		INPUT WATTS	MOUNTING	DESCRIPTION
			NO.	TYPE		NO.	TYPE			
☼	LITHONIA	LQM	1	LED	120, 277	-	-	1.2	CEILING	EXIT LIGHT, AC POWER ONLY, RED ILLUMINATED EXIT SIGN, HOUSING COLOR BY ARCH. DAMP LOCATION LISTED.
☼	LITHONIA	LHQM LED	2	1.5W	120, 277	-	-	3.0	WALL	LED EXIT-EMERGENCY LIGHT COMBO, (2) ADJ. HEADS, BATTERY BACK-UP, RED ILLUMINATED EXIT SIGN, HOUSING COLOR BY ARCH.
☼	LITHONIA	LHQM LED	2	1.5W	120, 277	-	-	3.0	CEILING	LED EXIT-EMERGENCY LIGHT COMBO, (2) ADJ. HEADS, BATTERY BACK-UP, RED ILLUMINATED EXIT SIGN, HOUSING COLOR BY ARCH.
☼	BARRON LIGHTING GROUP	TR-WB-BR-CL	2	6W XENON	120, 277	-	-	-	WALL	REMOTE EXTERIOR EMERGENCY LIGHT, PAINTABLE, BATTERY BACK-UP, W/ TEST SWITCH, WET LOC LISTED, NEC 700.16 COMPLIANT.
☼	LITHONIA	ELM2 LED	2	1.5 W	120, 277	-	-	1.4	SEE PLAN	GEN. PURPOSE EMERGENCY LED LIGHT, (2) ADJ. HEADS, BATTERY BACK-UP.
EMG-INV	-	-	-	-	120, 277	-	-	MFG	-	FIXTURE TO BE WIRED VIA EMERGENCY LIGHTING INVERTER WITH 90 MINUTE BATTERY BACK-UP. SEE RISER(S) AND DETAIL(S).


- NOTES:
- UNLESS OTHERWISE NOTED COLOR & FINISH OF FIXTURE HOUSING, BAFFLE, OR SIMILAR EXPOSED ELEMENTS TO BE BY ARCHITECT.
 - EXIT AND EMERGENCY LIGHTING FIXTURES SHALL BE CIRCUITED TO AN UNSWITCHED LEG OF A NORMALLY ON LOCAL LIGHTING CIRCUIT (UNLESS NOTED OTHERWISE).INCLUDE 90 MINUTE BATTERY BACKUP & TESTING MEANS UNLESS OTHERWISE NOTED.
 - FIXTURES WIRED VIA EMERGENCY LIGHTING INVERTER WHERE "EMG-INV" IS SHOWN.
 - ALL LAMPS OF A SINGLE FIXTURE TYPE INSTALLED IN EACH AREA/ROOM/SPACE ARE TO BE OF SAME TEMPERATURE/COLOR.

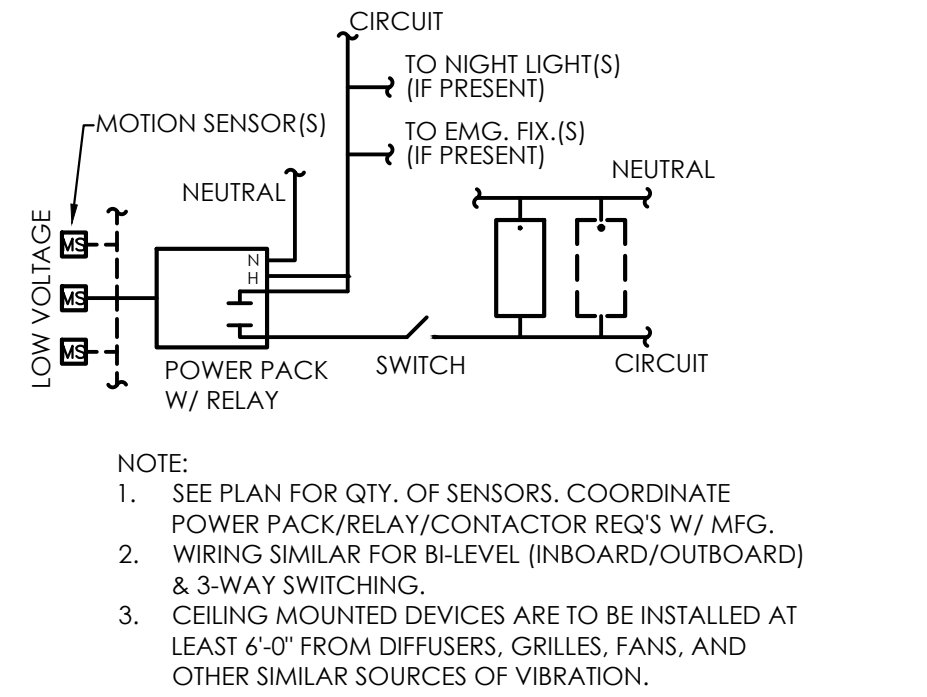

7 MOTION SENSOR WIRING (LOW VOLT.)
NO SCALE

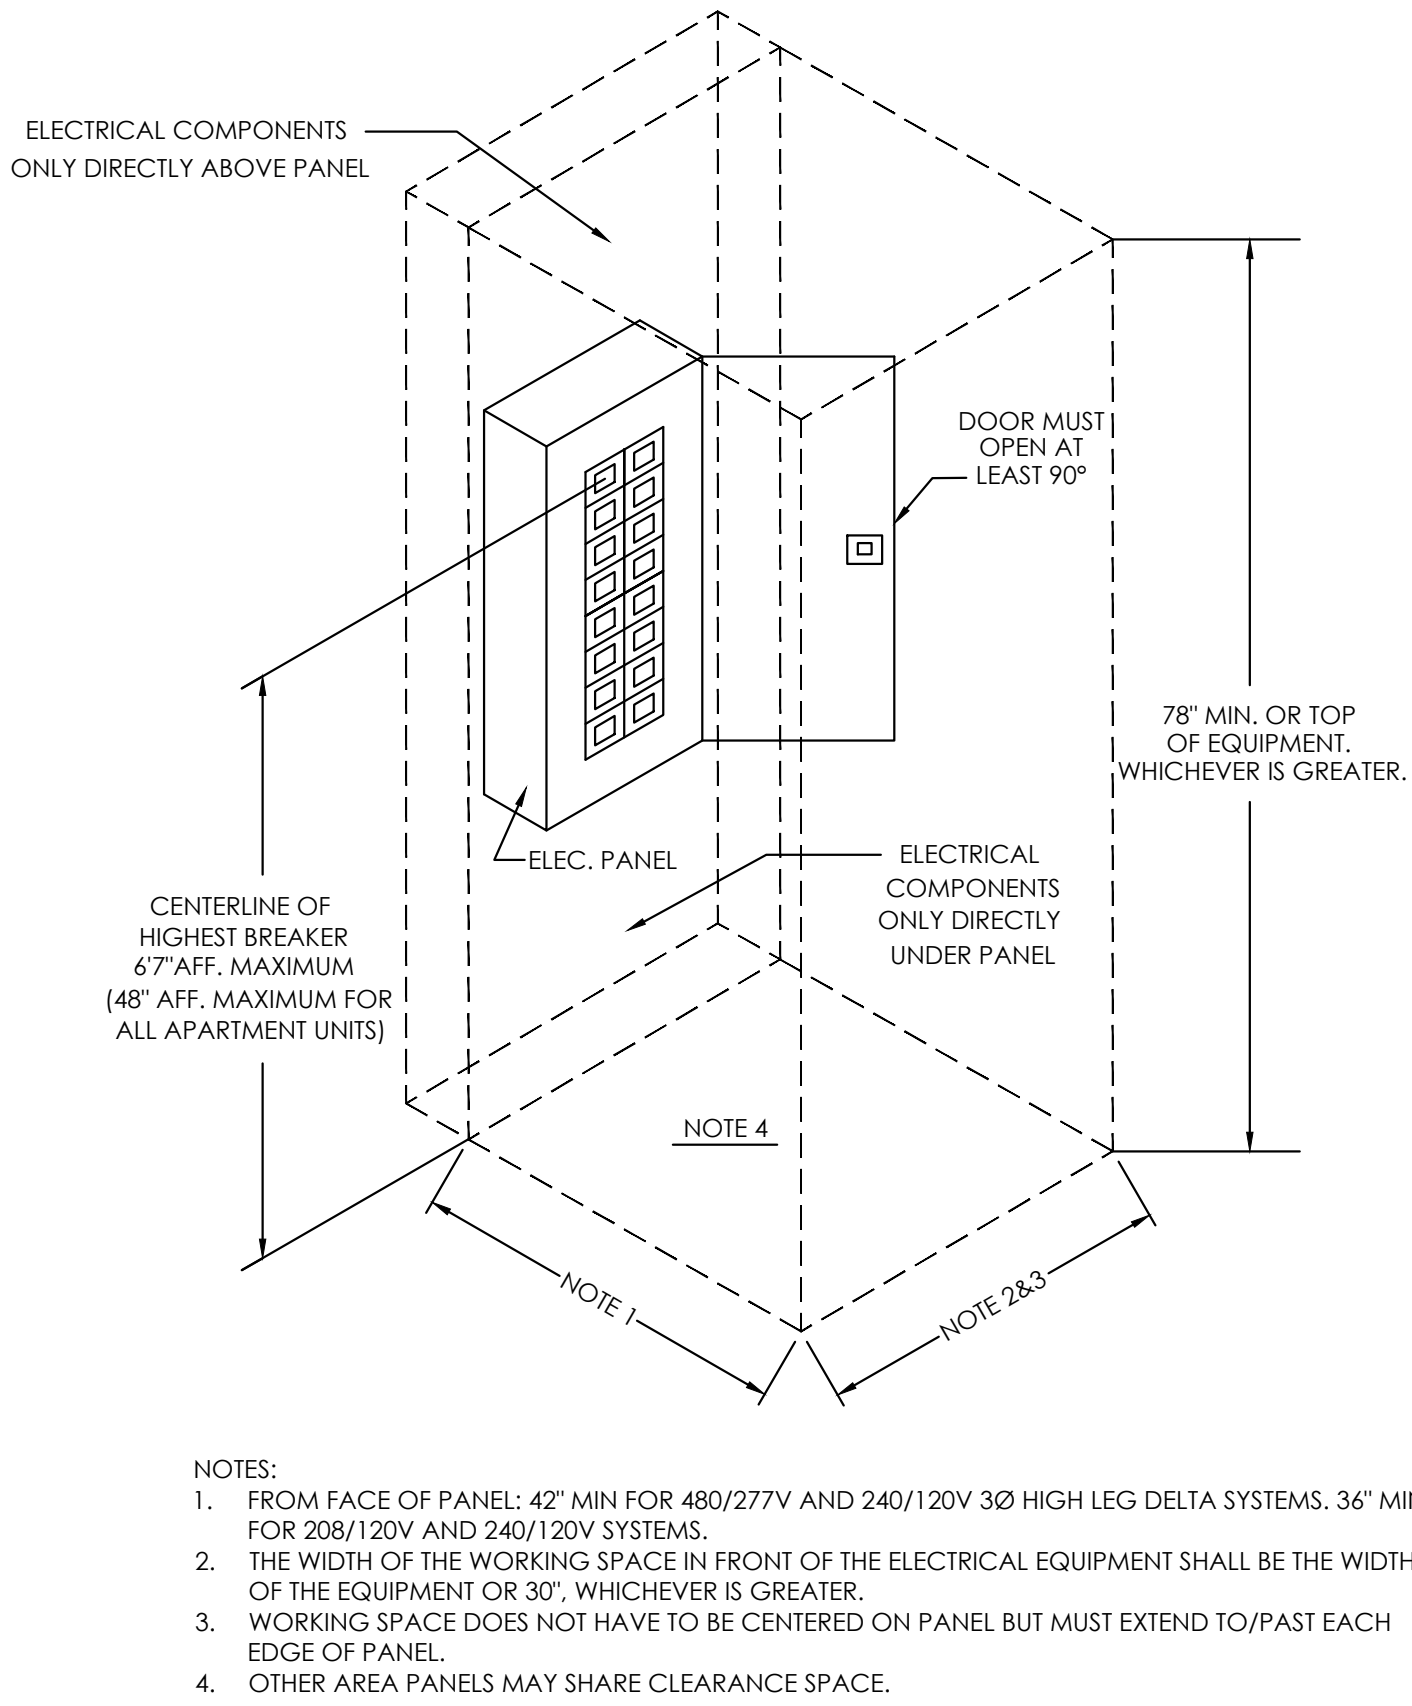


3 ELECTRICAL PANEL MOUNTING DETAIL
NO SCALE

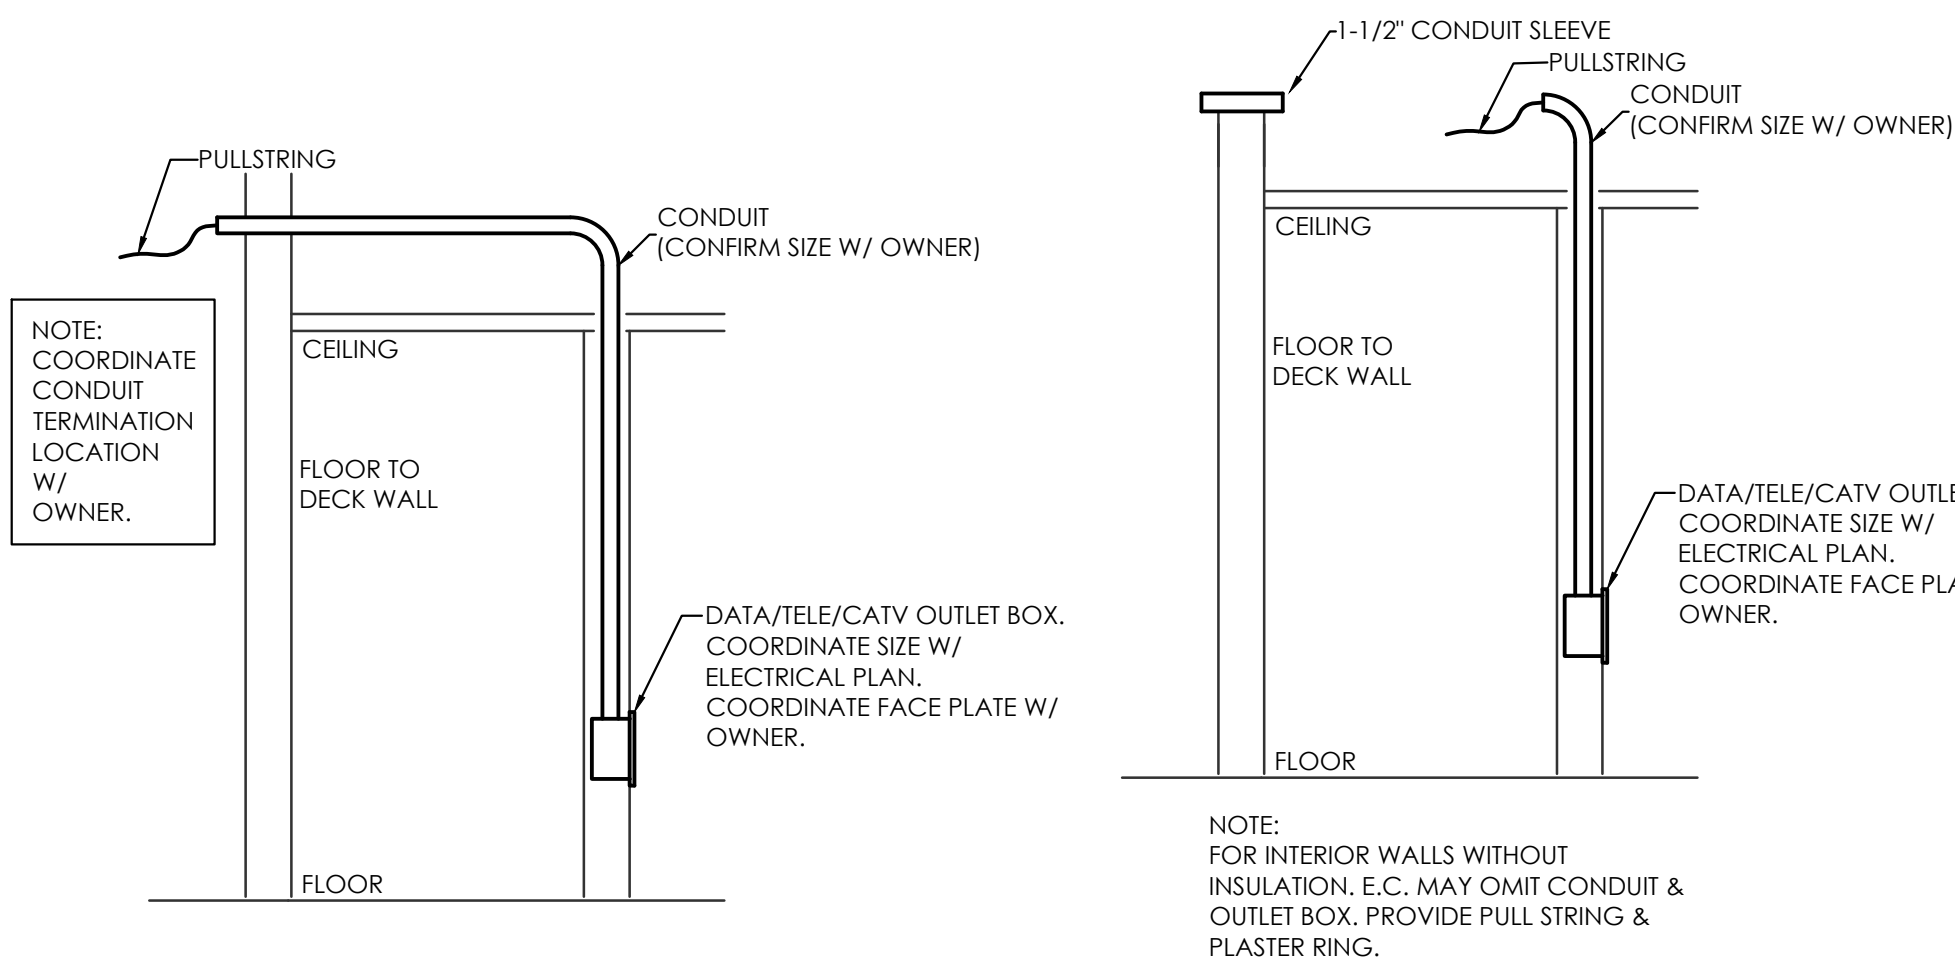


6 DATA/TELE/CATV OUTLET (HARD CEIL)
NO SCALE


5 DATA/TELE/CATV OUTLET (LAY-IN CEIL)
NO SCALE

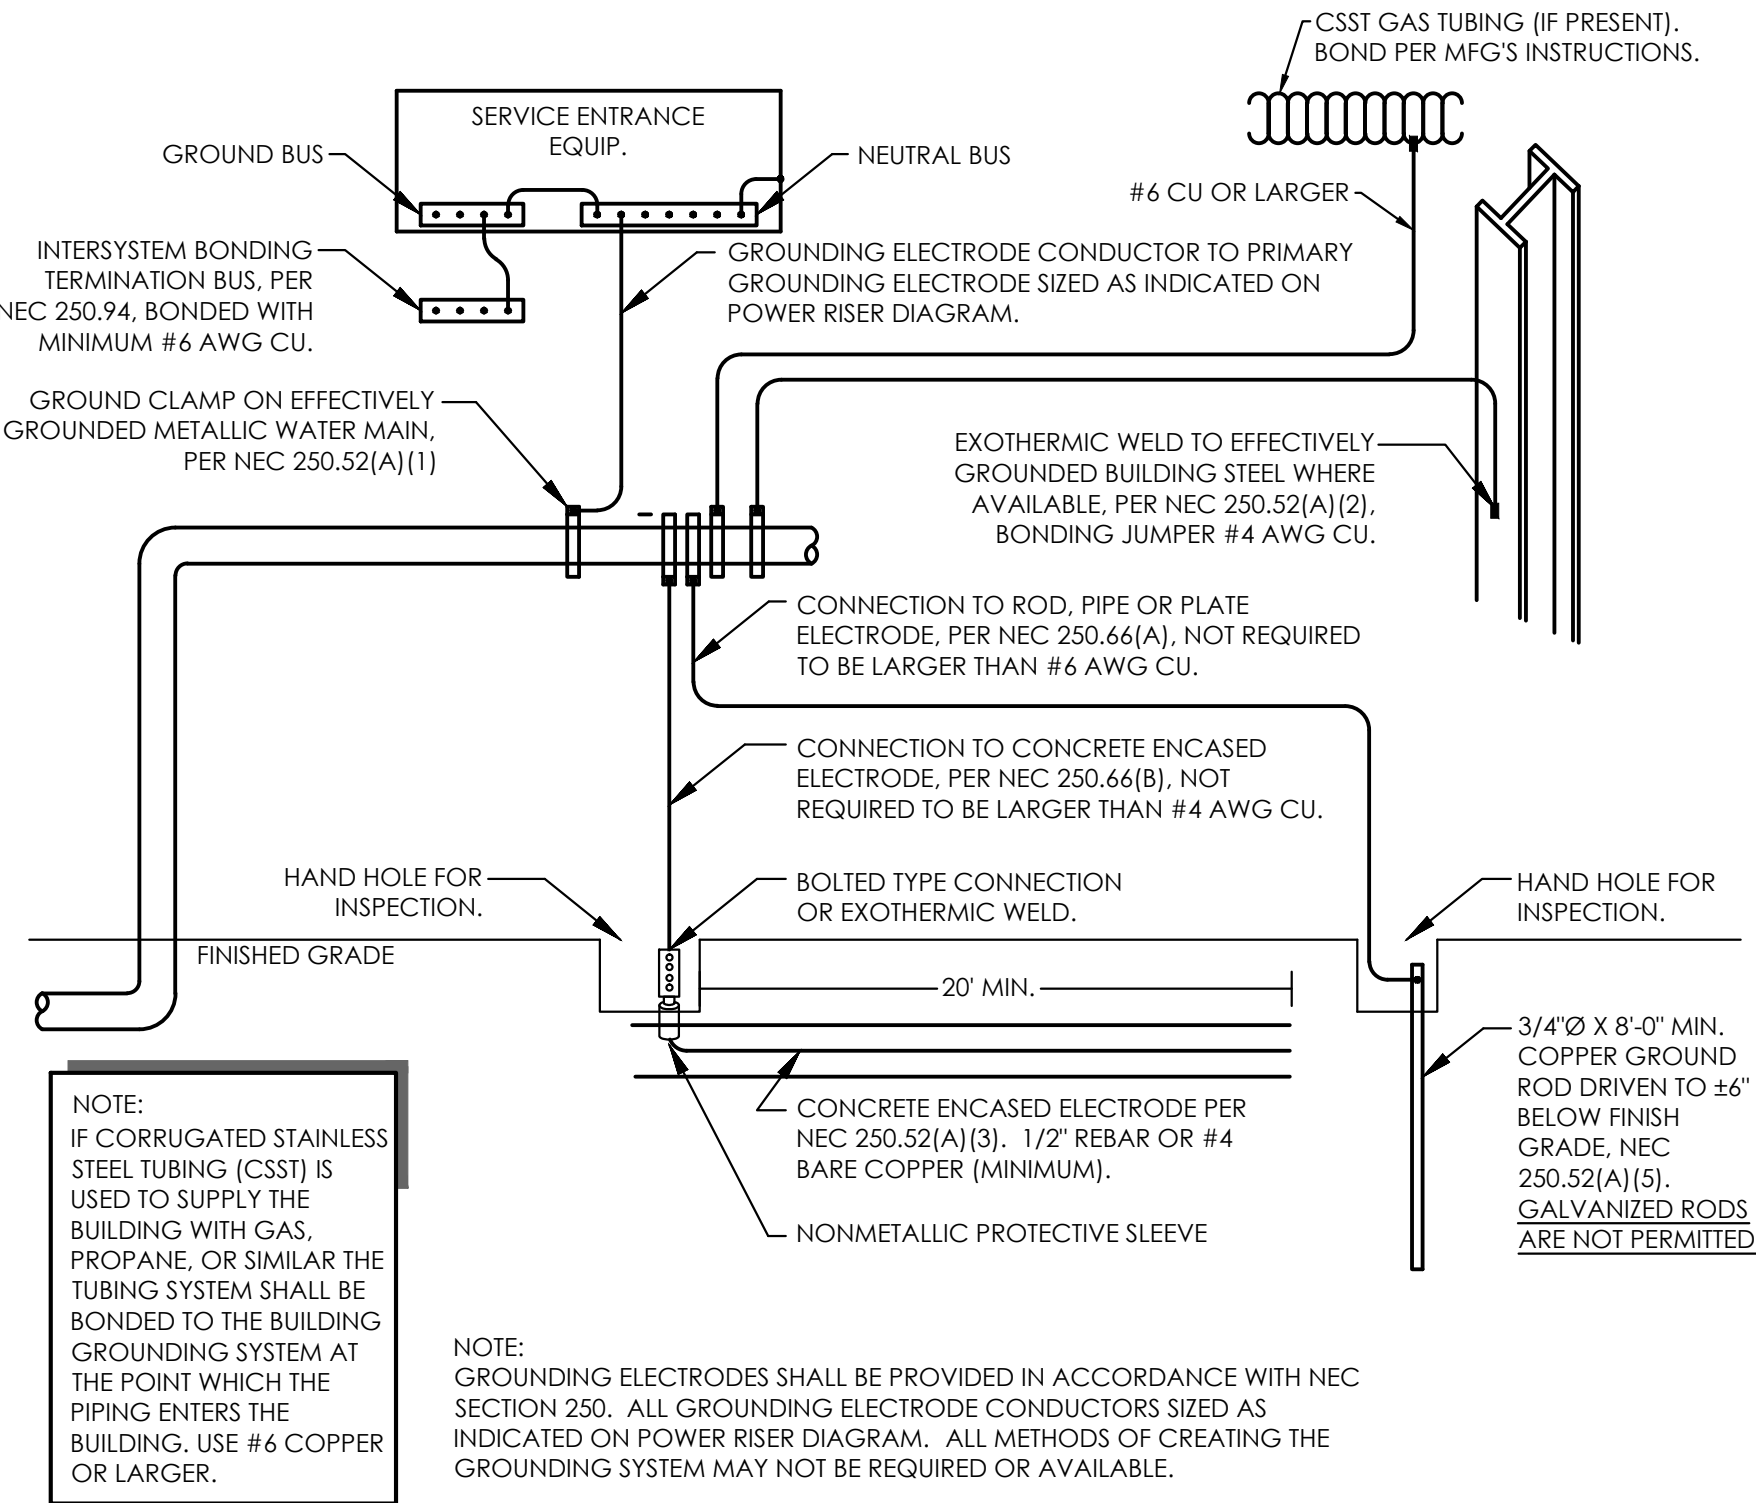


2 GROUNDING DETAIL
NO SCALE

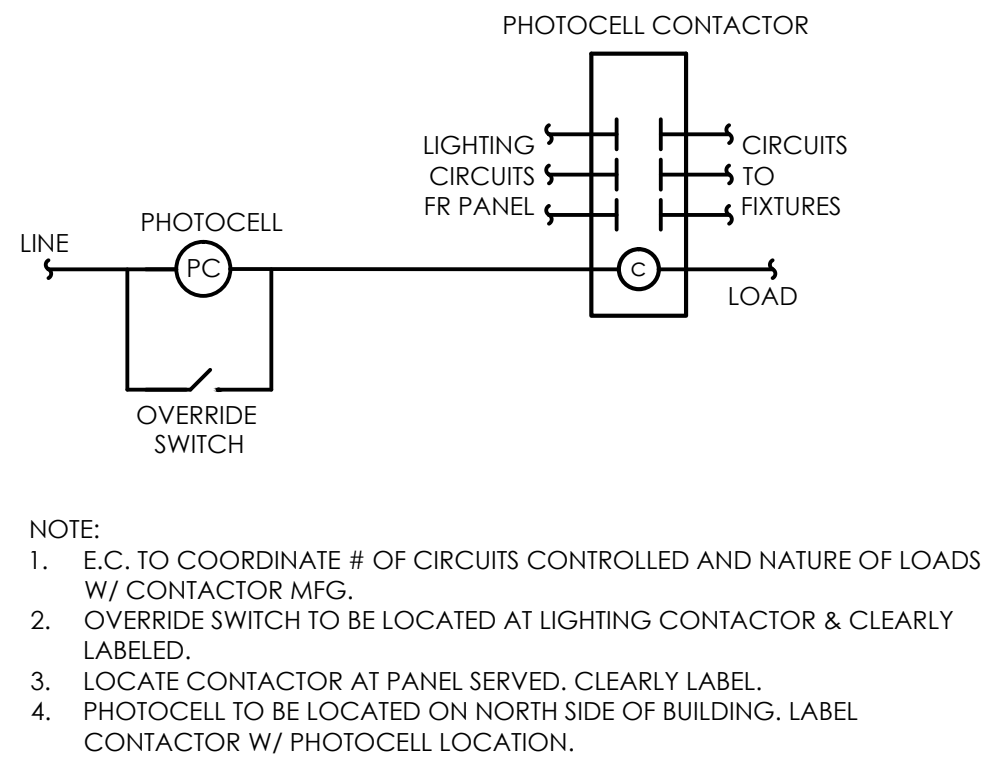


9 LIGHTING CONTACTOR PHOTOCELL
NO SCALE

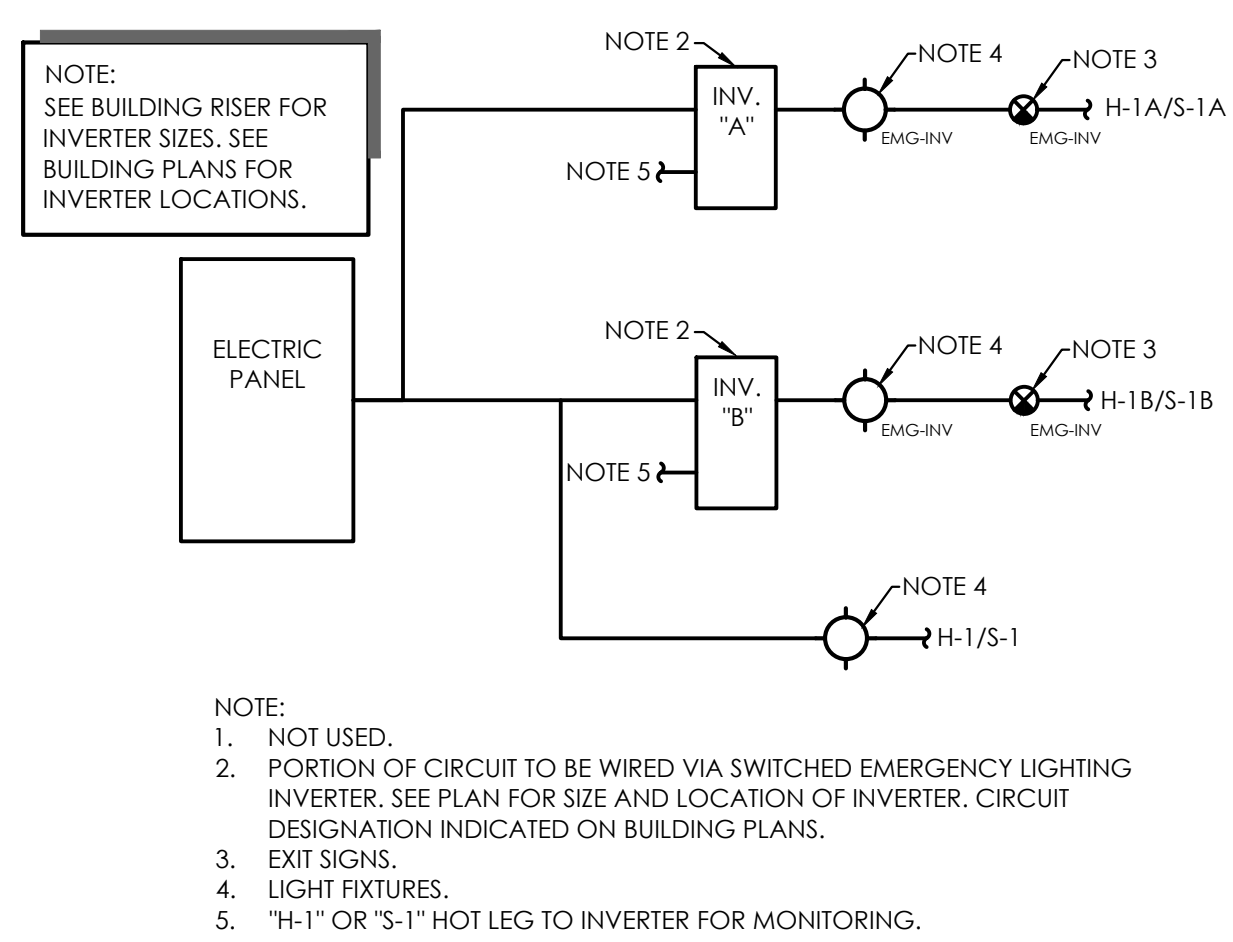

8 EMERGENCY LIGHTING INVERTER
NO SCALE

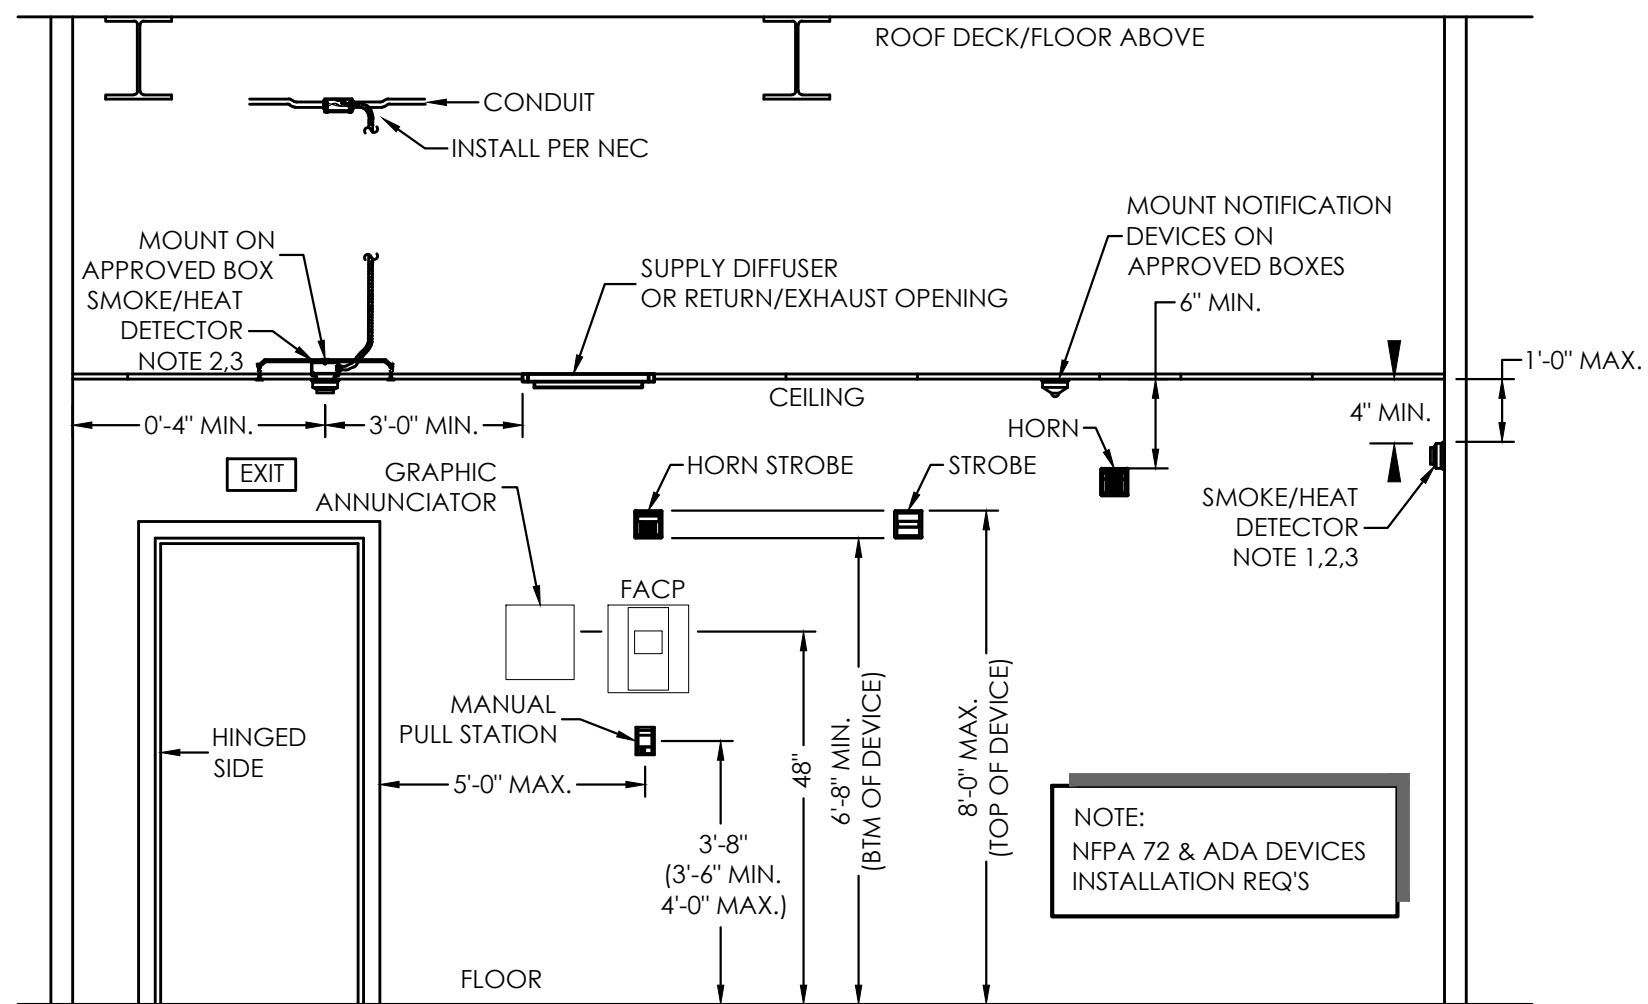

4 FIRE ALARM AND SIMILAR DEVICE LOCATIONS
NO SCALE

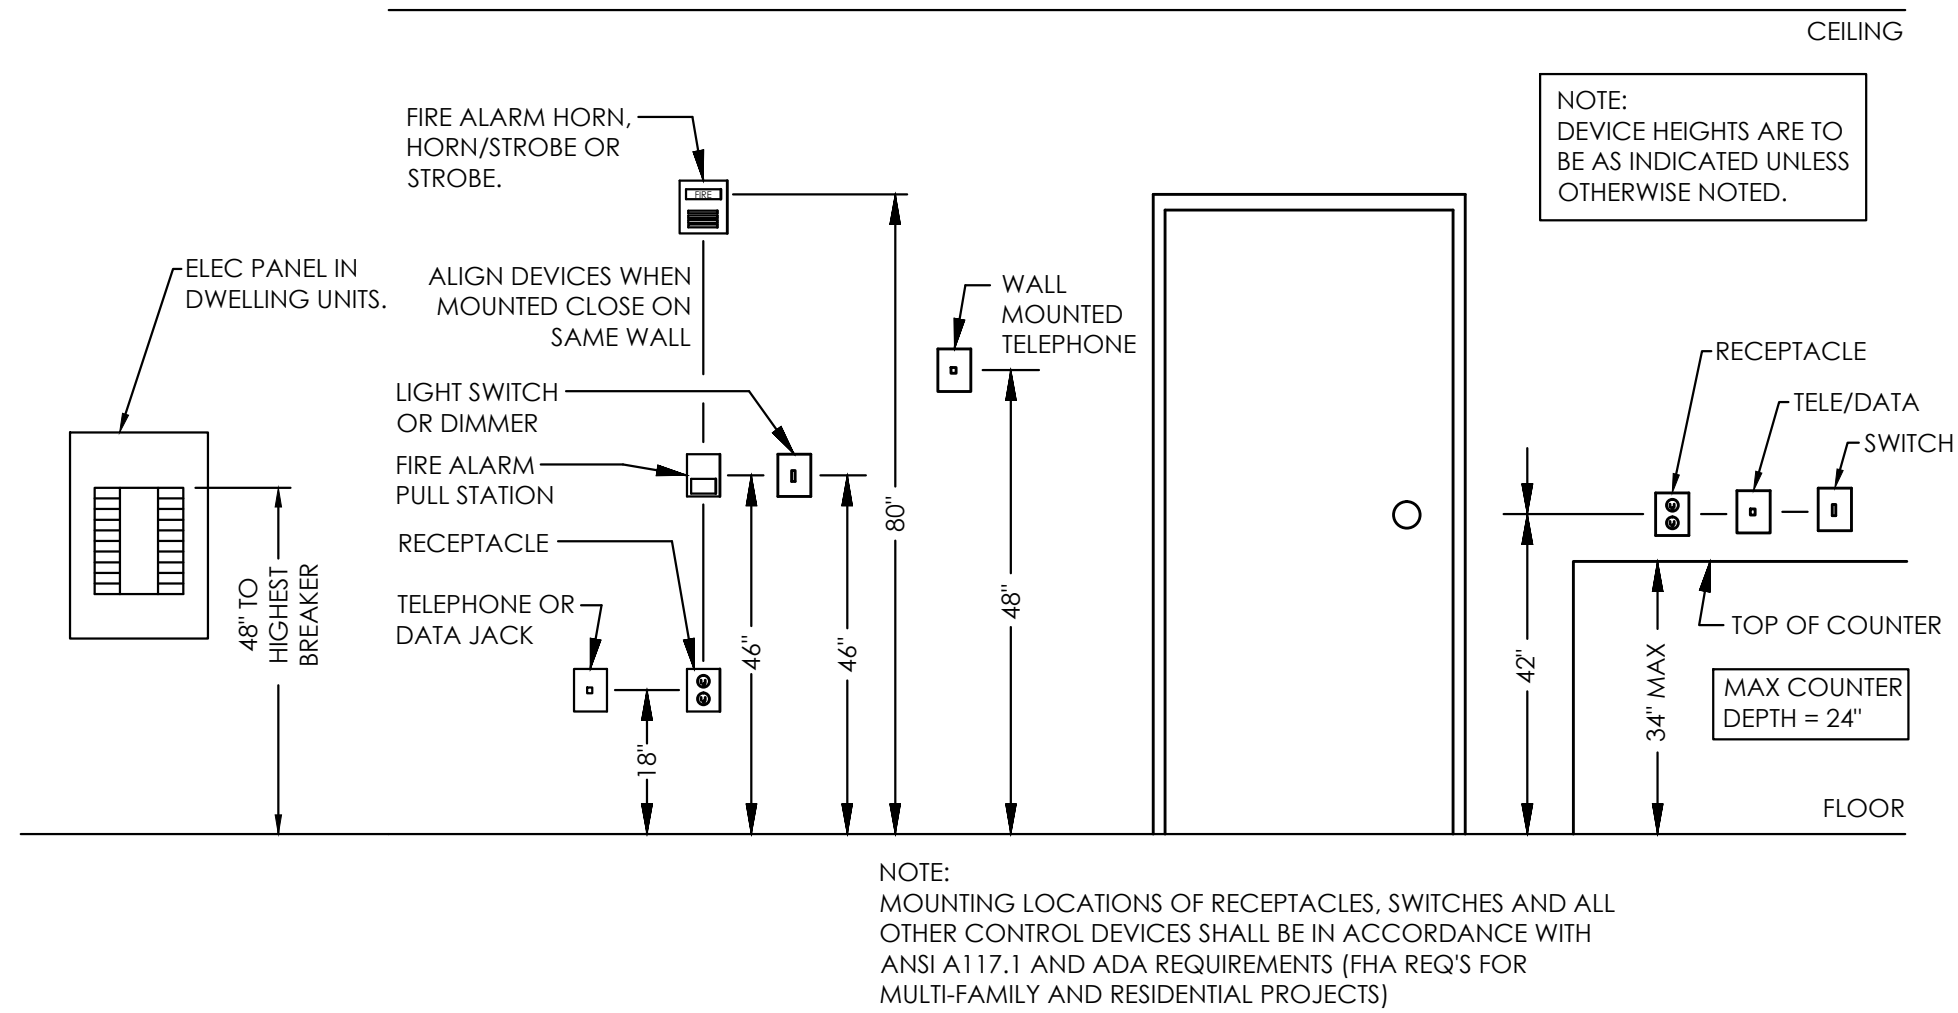

1 TYPICAL DEVICE MOUNTING HEIGHTS
NO SCALE

PLANWORX
ARCHITECTURE

5711 SIX FORKS ROAD, SUITE 100
RALEIGH NC 27609
website www.planworx.com

Oasis at Surfside - Phase II

Zimmer Development Company

Cape Coral, Florida

PERMIT SET

MAPLE
ENGINEERING, PLLC

708 E. HARRIS ST.
RALEIGH, NC 27605 S.E.#: P 00990
P 919 341-4847 F 919 890-3797
PLUMBING MECHANICAL ELECTRICAL

PROGRESS DATE:	11/17/21	REVISIONS	NUMBER	DATE	INITIALS	DESCRIPTION
ISSUE DATE:						
PROJECT NO:	002221					
DRAWN BY:	NHIV					
CHECKED BY:	ZLT					
SHEET TITLE:	ELECTRICAL DETAILS					
SHEET NUMBER:						

E0.02