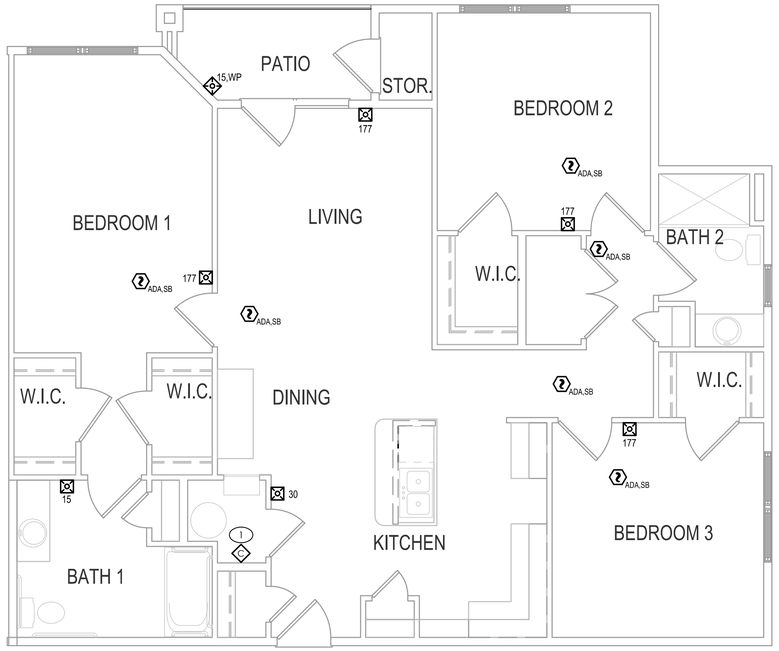

3 FIRE ALARM UNIT PLAN - TYPE 3.0 MOBILITY
SCALE: 1/4" = 1'-0"

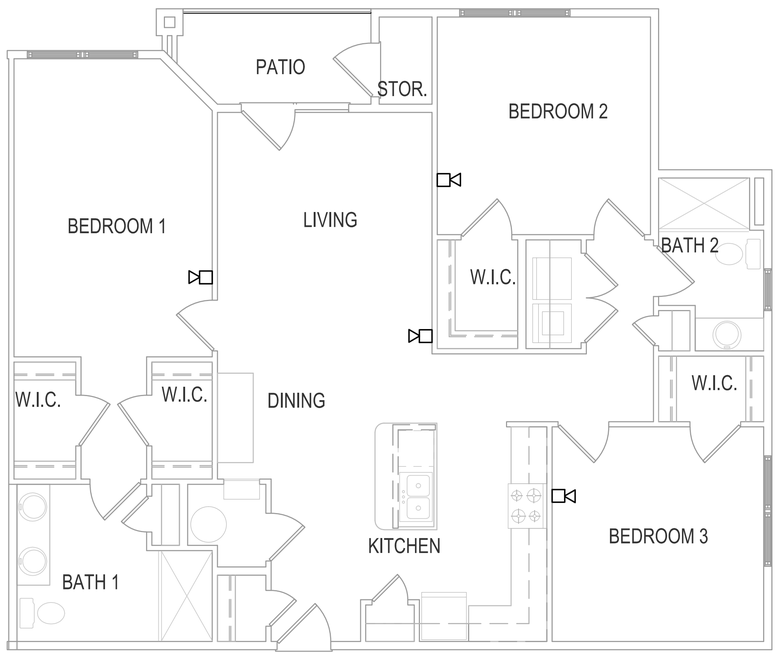

2 FIRE ALARM UNIT PLAN - TYPE 3.0 FAIR HOUSING
SCALE: 1/4" = 1'-0"

GENERAL FIRE ALARM NOTES

1. SEE FIRE ALARM DEVICE DETAIL (SHEET FA0.01) FOR MORE INFORMATION. DETAIL INCLUDES SPECIFIC SMOKE DETECTOR PLACEMENT DISTANCES FROM BATHROOM/SHOWER ROOM DOORS AND PERMANENTLY INSTALLED COOKING APPLIANCES.
2. SEE ELECTRICAL PLANS FOR STAND ALONE SMOKE DETECTORS IN NON-ADA UNITS.
3. SEE BUILDING PLANS FOR UNIT DEMISING WALL AND FLOOR/CEILING RATINGS.
4. ALL FIRE ALARM DEVICES IN APARTMENTS TO BE LOW FREQUENCY TYPE.
5. IN ALL NON-TYPE A APARTMENT UNITS THE FIRE ALARM NAC CIRCUIT IS TO BE EXTENDED INTO THE VICINITY OF ONE 120 VOLT SMOKE DETECTOR (SEE ELECTRICAL PLANS FOR LOCATIONS) IN COMPLIANCE WITH IFC 907.5.2.3.3 AND CHAPTER 11 OF ICC A117.1 2017.
6. NAC CIRCUITS AND ASSOCIATED BATTERY PANELS SERVING DWELLING UNITS ARE TO BE DESIGNED WITH 20% SPARE CAPACITY FOR FUTURE VISUAL NOTIFICATION DEVICES.

TAGGED NOTES - THIS SHEET

(1) PROVIDE CONTROL MODULE TO ACTIVATE NOTIFICATION APPLIANCES WITHIN MOBILITY UNIT DURING BUILDING WIDE ALARM OR APARTMENT UNIT SMOKE DETECTION.

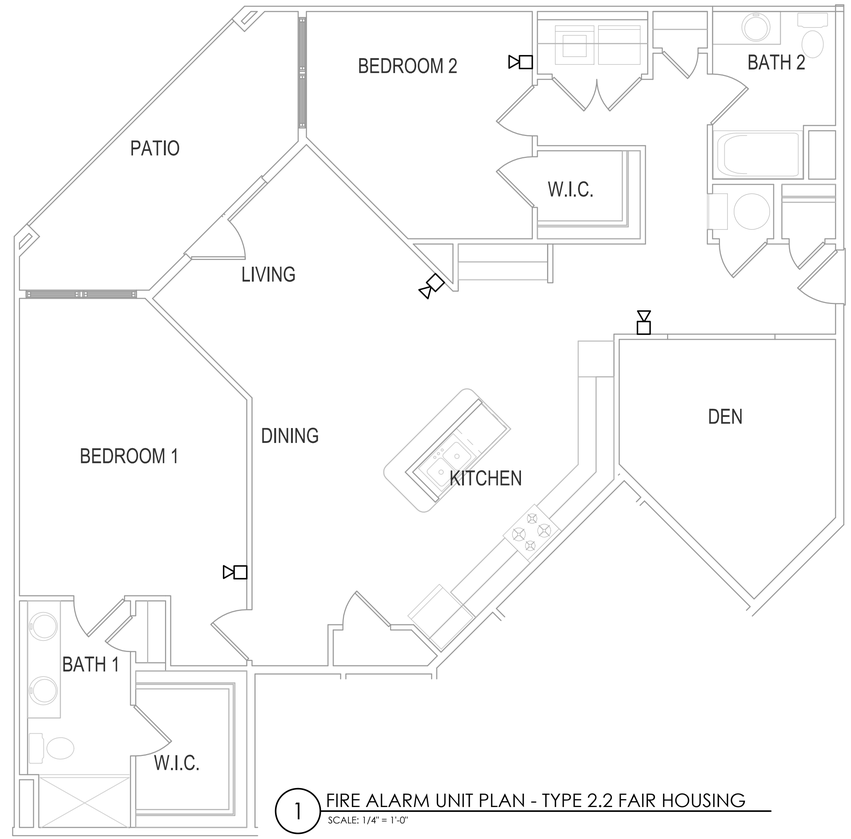

1 FIRE ALARM UNIT PLAN - TYPE 2.2 FAIR HOUSING
SCALE: 1/4" = 1'-0"

1. All drawings are to be coordinated with all site information by owner and contractor, and applicable codes.
2. Contractor is to notify architect immediately of conditions or items varying from depicted information.
3. Planworx Architecture, P.A. is not responsible for constructed variations from the information depicted.
4. Planworx Architecture, P.A. will not assume any liability for expenses associated with errors and omissions on these drawings unless offset by verified construction savings as a result of planworx architecture, P.A. Design.
5. Planworx Architecture, P.A. retains ownership of all of designs depicted and implied herein.
6. Planworx Architecture, P.A. is not responsible for estimating, maintaining, or regulating construction costs associated with these plans.

© Copyright 2021 - PLANWORX ARCHITECTURE, P.A. All rights reserved. Reproduction of this sheet, in whole or in part, is strictly prohibited. Plans may be used once by client. Unauthorized use strictly prohibited. PLANS NOT VALID FOR CONSTRUCTION W/O APPROPRIATE PROFESSIONAL SEALS.

11/17/2021 2:55 PM
PLX-2107-FA122.DWG

PLANWORX
ARCHITECTURE
5711 SIX FORKS ROAD, SUITE 100
RALEIGH NC 27609
website www.planworx.com

ZACK L. TOMLIN LICENSED No 79002 STATE OF FLORIDA PROFESSIONAL ENGINEER

Digitally signed by Zack L. Tomlin, PE
DN: cn=Zack L. Tomlin, PE, o=Maple Engineering, PLLC, ou=Zack L. Tomlin, State of Florida, Professional Engineer, License No. 79002. This item has been digitally signed and sealed by Zack L. Tomlin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.,
email=ZLT@maple-eng.com, c=US
Date: 2021.11.17 16:22:33 -05'00'

Oasis at Surfside - Phase II
Zimmer Development Company
Cape Coral, Florida
PERMIT SET

MAPLE
ENGINEERING, PLLC
708 ST. MARYS ST
RALEIGH, NC 27605 LIC.#: P-0990
P:919-341-4247 F:919-890-3797
PLUMBING MECHANICAL ELECTRICAL

PROGRESS DATE:			
ISSUE DATE:	11/17/21		
REVISIONS NUMBER	DATE	INITIALS	DESCRIPTION

PROJECT NO: 002221
DRAWN BY: NHV
CHECKED BY: ZLT

SHEET TITLE:
FIRE ALARM UNIT PLANS

SHEET NUMBER:
FA1.22

© 2021 MAPLE ENGINEERING, PLLC EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF MAPLE ENGINEERING, PLLC.